


Lovibond® Water Testing

Tintometer® Group



PDM/TTC Dipslide, TVC/P.aeruginosa, Dual Sided, 10 pack

With dual agar for the determination of the total count / Pseudomonas

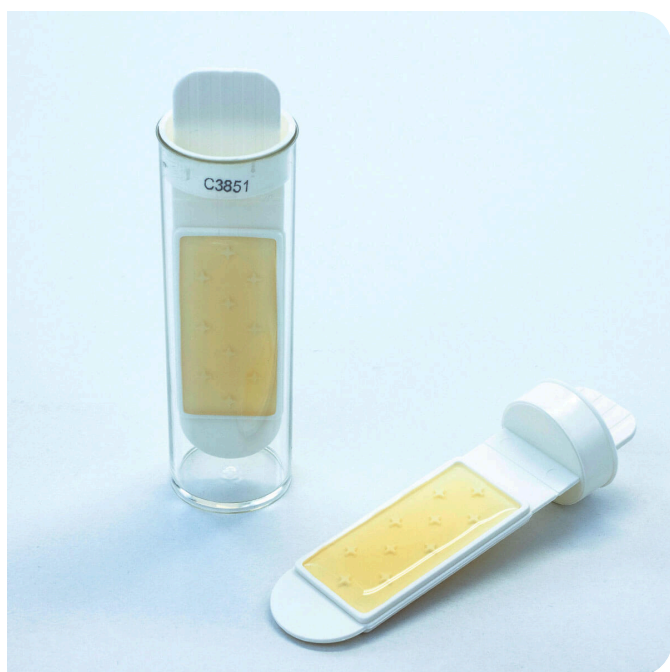

- Determine aerobic and anaerobic bacteria levels
- Early indication of bacteria proliferation
- Results in 48 hours
- Inexpensive

Part Number: 56B010710

Guidelines to advise on the correct practices to control legionella bacteria in water systems exist worldwide. Suppressing bacteria levels does substantially reduce the possibility of an outbreak of this often fatal disease. Guidelines recommend introducing a monitoring and control program. This program includes the testing of cooling tower waters with dipslides on a regular basis. A full range of dipslides is available for semiquantitative determination of aerobic and anaerobic bacteria populations in industrial and recreational waters. Dipslide accuracy is limited due to the small sample size, but if used correctly and incubated at a constant temperature using the Lovibond® dipslide incubator, they are excellent for trend analysis and can give an early indication of bacteria proliferation.

Industry

Chemical Industry | Food and Beverage Industry | Industries Others | Marine Industry | Oil and Gas | Pharmaceutical Industry | Power and Energy

PDM/TTC Dipslide, TVC/P.aeruginosa, Dual Sided, 10 pack

This dipslide is provided with dual agar. It allows the simultaneous detection of Pseudomonas and the total number of bacteria. A nutrient agar contains a TTC additive and a Pseudomonas base medium. The dipslide complies with the standards HSG282 and HTM 01-06.

Title	Part Number
Dipslide Comparator - App	
DI10 Incubator	56B000701